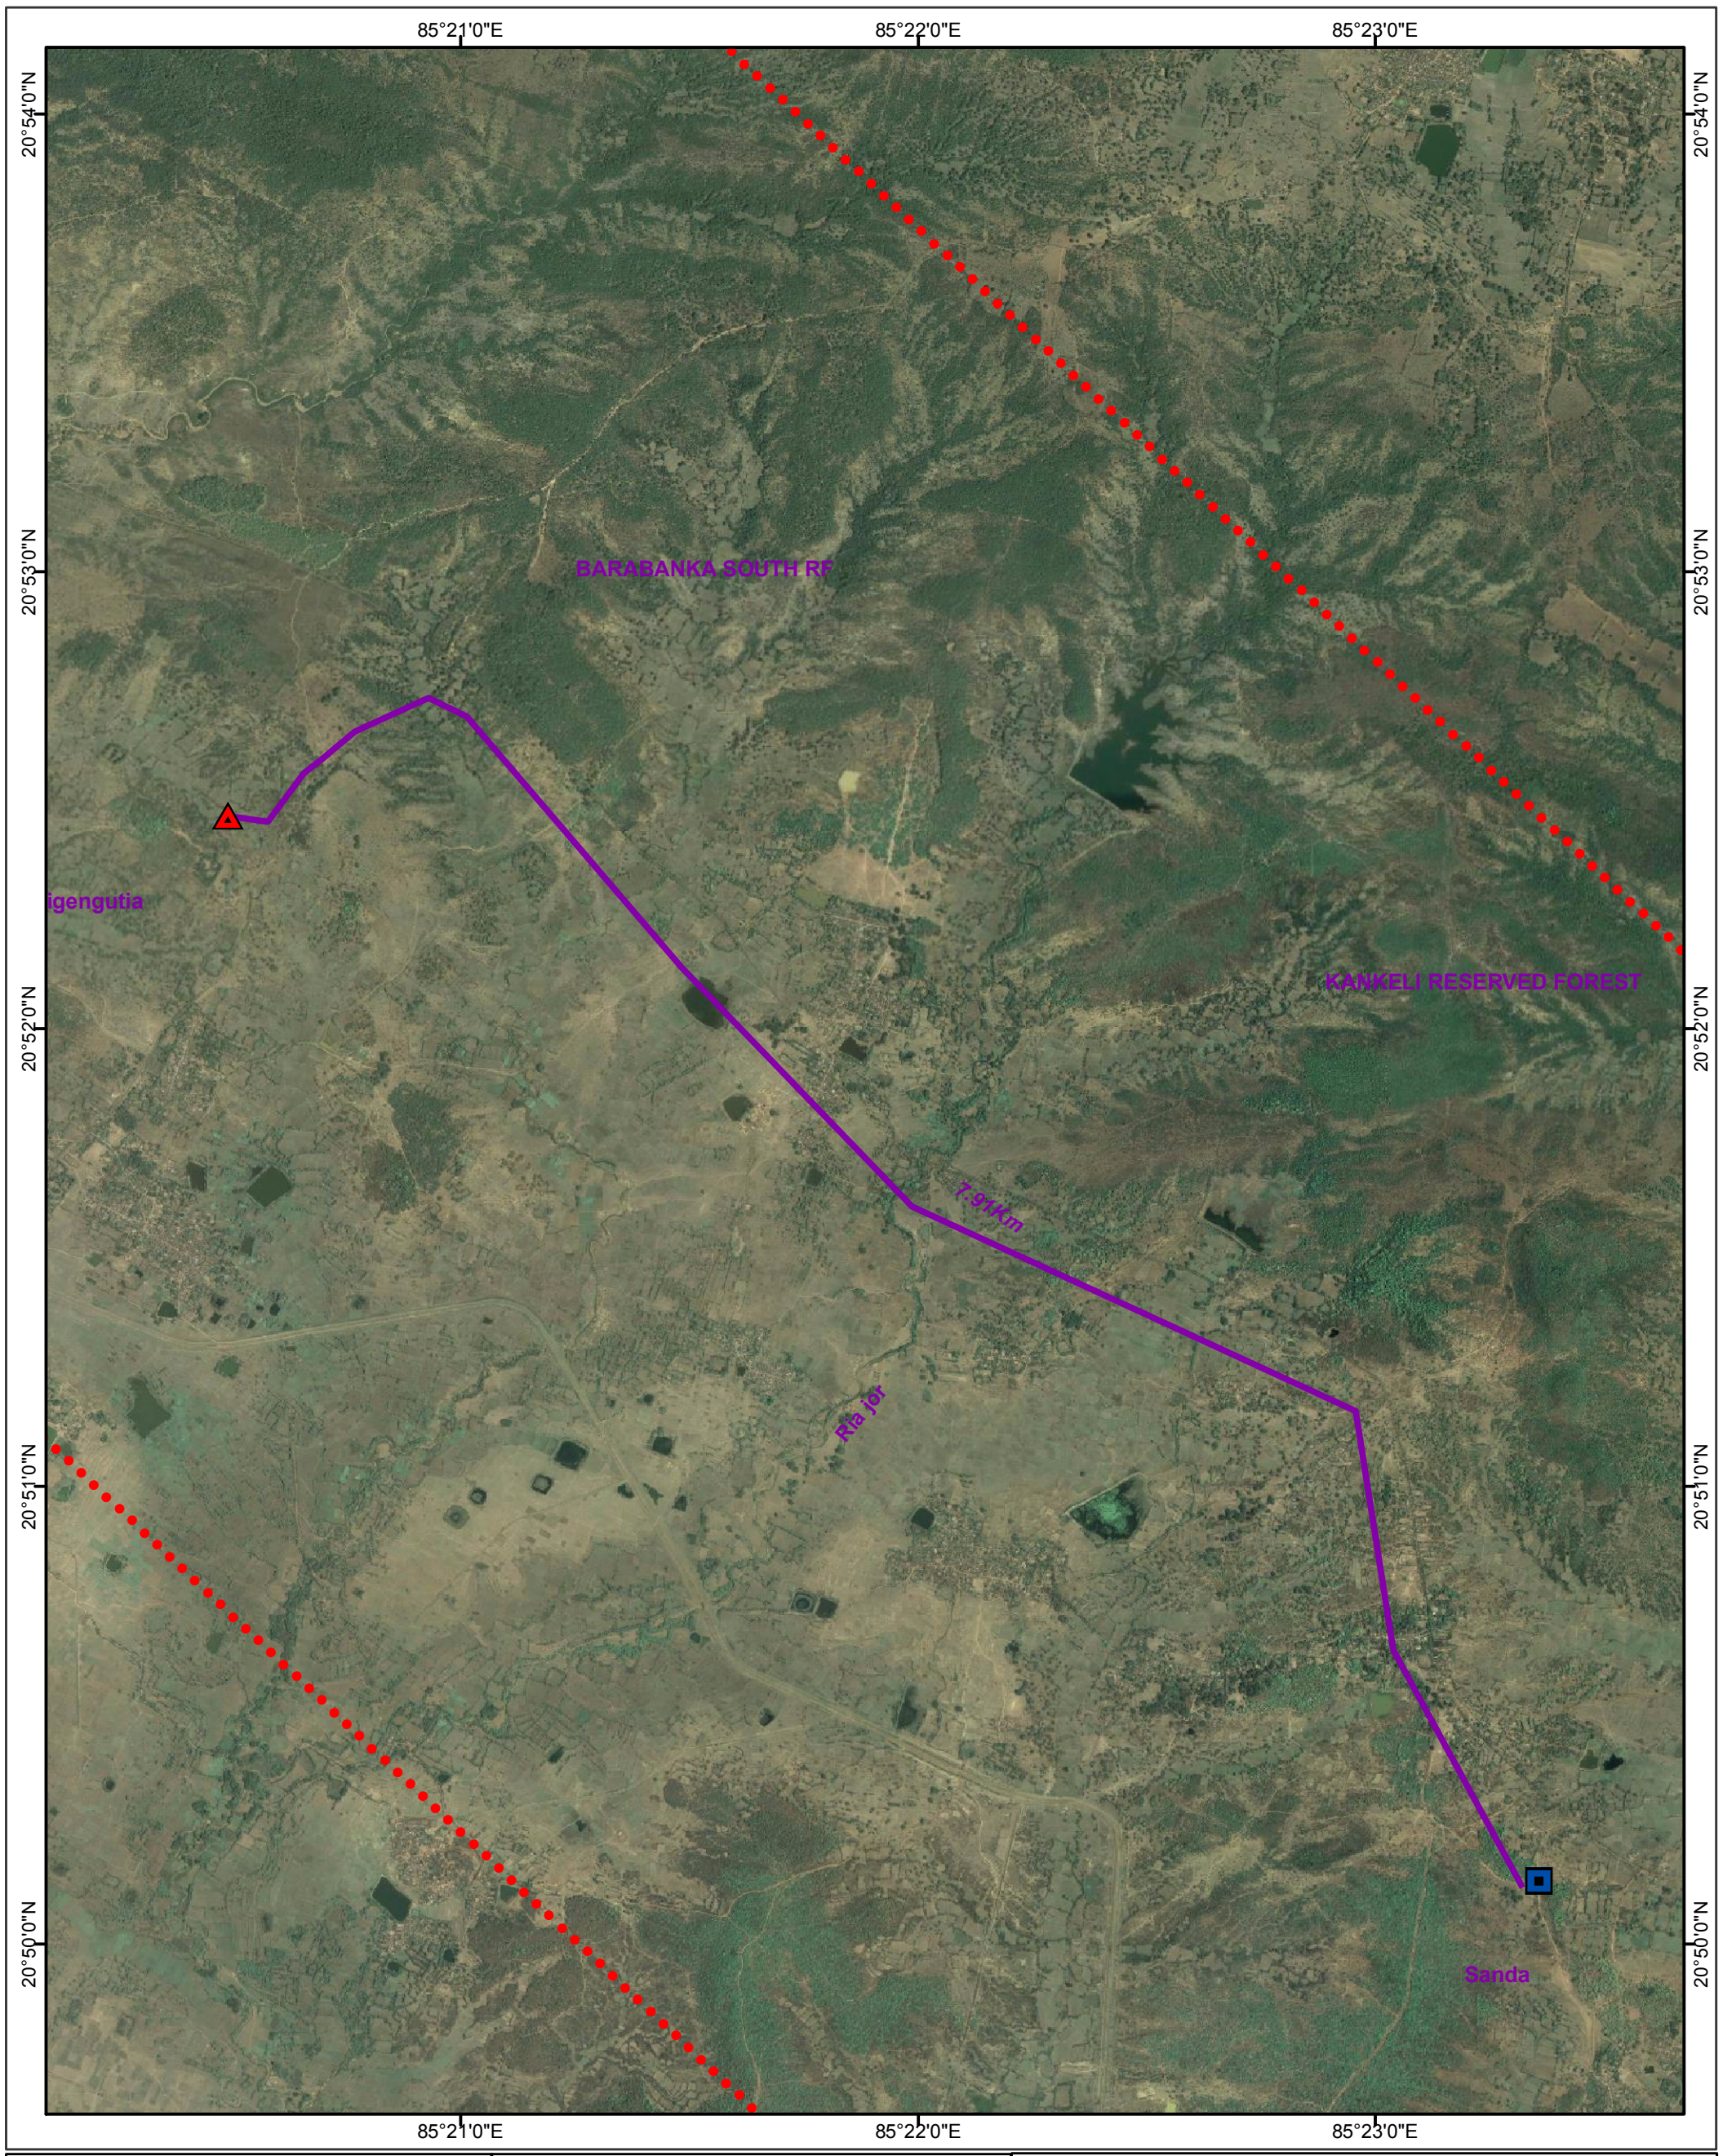

Plate : DKL 3a

CESU

Proposed alignment of 11 KV line under Infrastructure Development Plan

Sanda - Panigengutia

N

500 250 0 500 1,000

Meters

Proposed location of 33/11 KV s/s or Source Location

Target Location

Proposed Power Line

Panigengutia

Sanda — *7.91Km*

Estimated Length of 11 KV line = 7.910 Km

Prepared by:

SPARC Igniting innovations

Spatial Planning & Analysis Research Centre Pvt. Ltd.
E/11, Infocity, Patia, Bhubaneswar