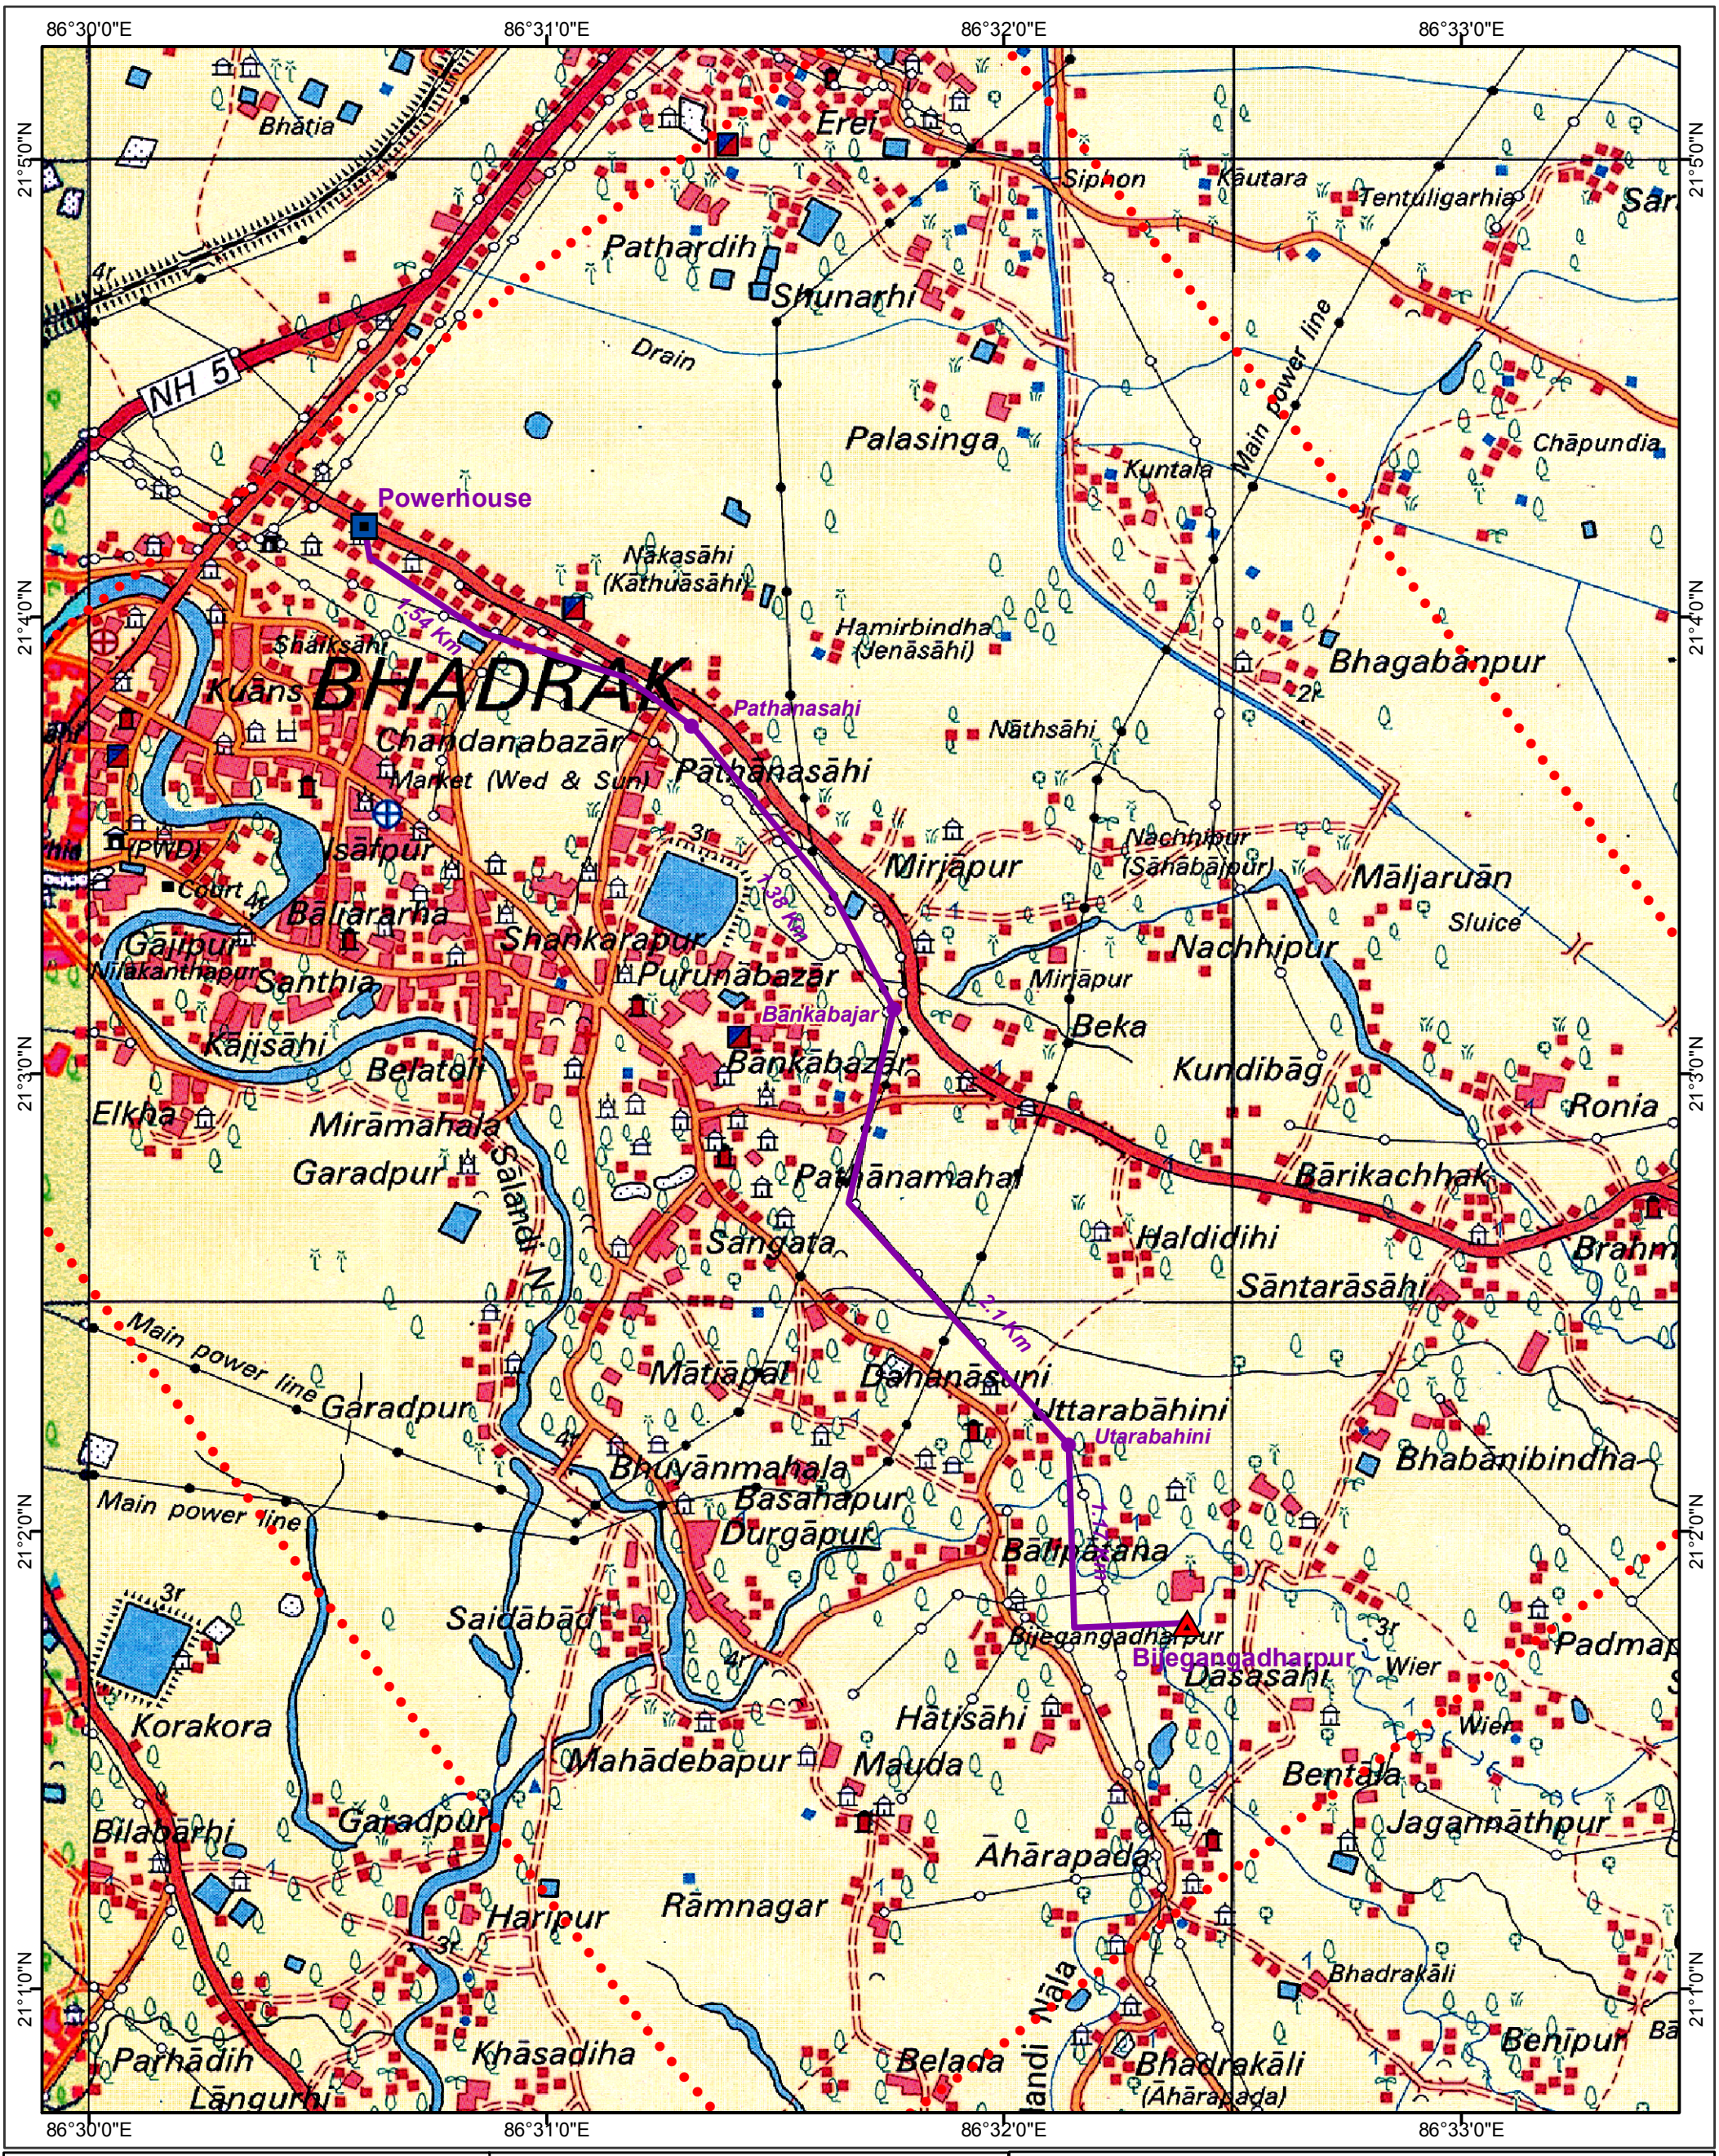

Plate : BDK 1b

NESCO

Proposed alignment of 33KV line under Infrastructure Development Plan

Powerhouse - Bijegangadharpur

N

500 250 0 500 1,000

Meters

Existing location of 132/33 KV s/s or Tapping location on existing 33 KV line

Proposed location of 33/11 KV s/s

Buffer Line (3 Km from Point)

Proposed Power Line (Option 1)

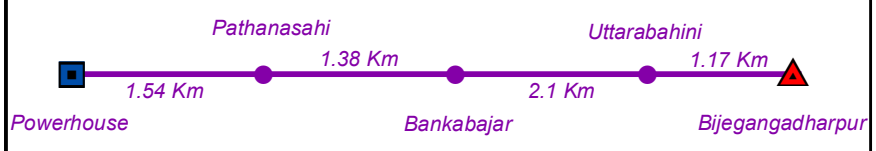

Estimated Length of 33 KV line = 6.2 Km

Prepared by:

SPARC Igniting innovations

Spatial Planning & Analysis Research Centre Pvt. Ltd.
E/11, Infocity, Patia, Bhubaneswar