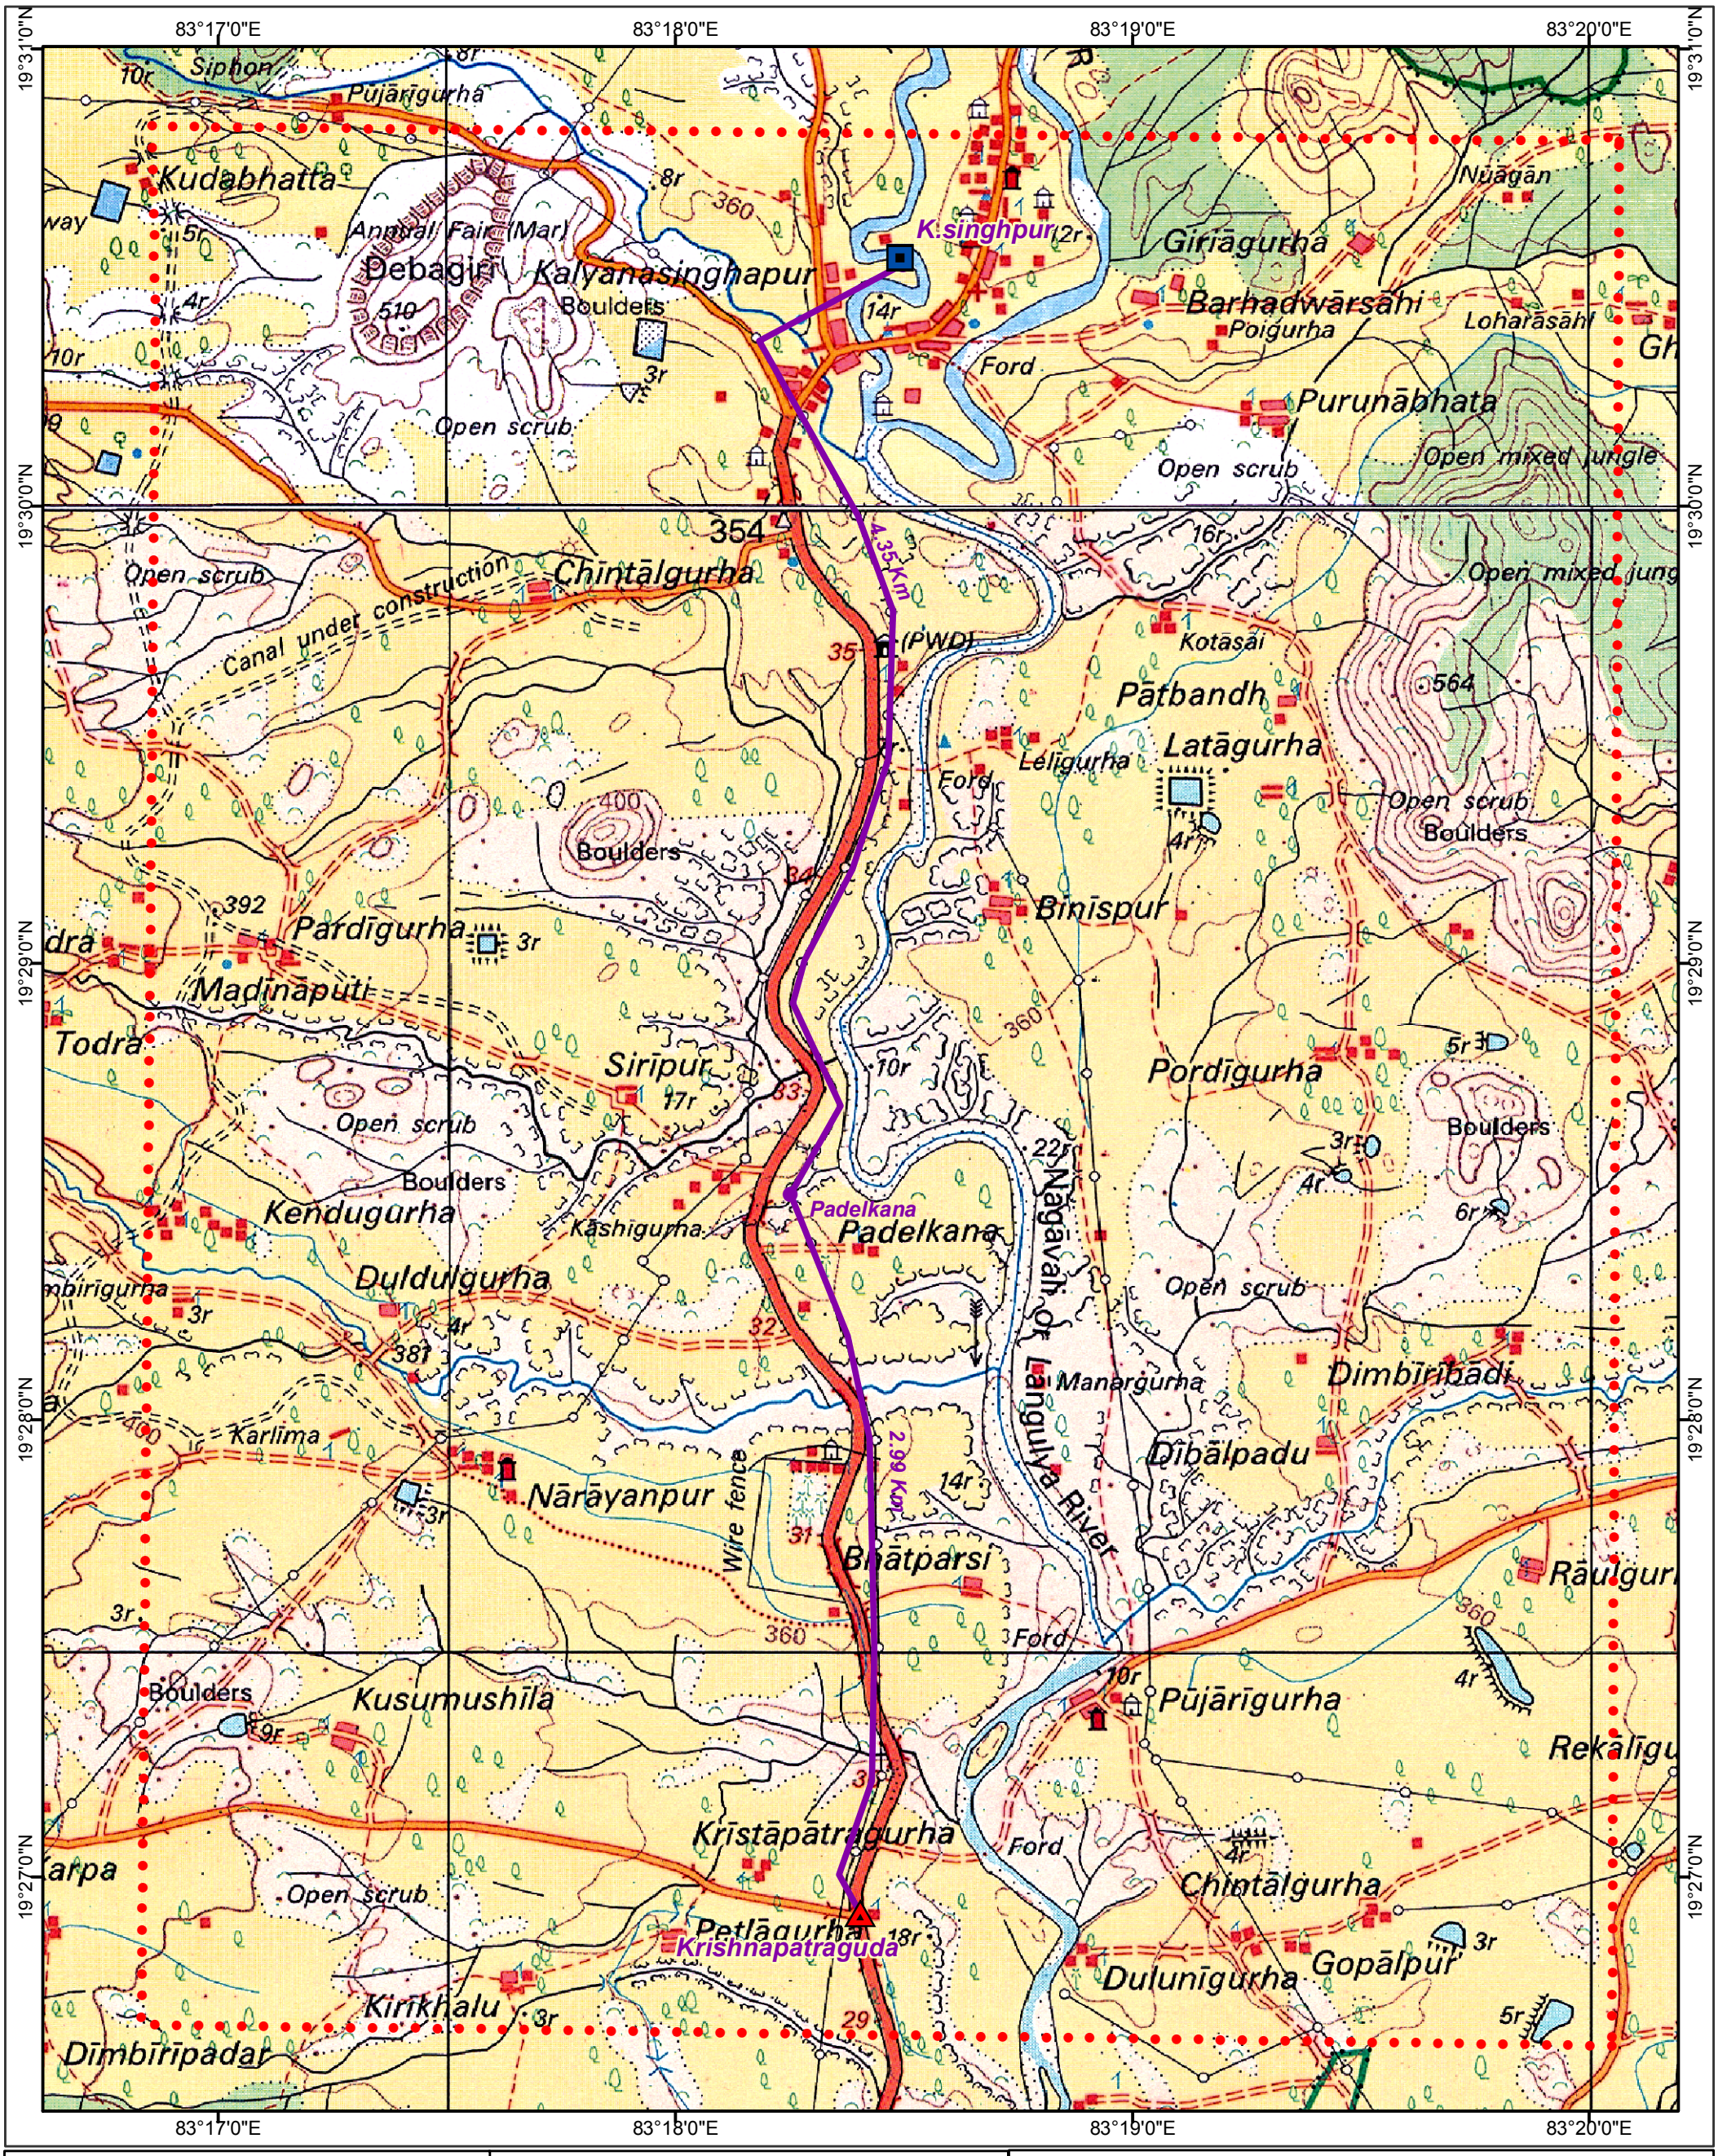

Plate : RAY 1b

SOUTHCO

Proposed alignment of 11 kV line under Infrastructure Development Plan

K.Singpur - Krishnapatraguda

N

500 250 0 500 1,000

Meters

Proposed location of 33/11 KV s/s or Source Location

Target Location

Buffer Line (3 Km from Point)

Proposed Power Line

K.Singpur — 4.35 Km — Padelkana — 2.99 Km — Kristapatraguda

Estimated Length of 11 kV line = 7.34 Km

Prepared by:

SPARC
Igniting Innovations

Spatial Planning & Analysis Research Centre Pvt. Ltd.
E/11, Infocity, Patia, Bhubaneswar